

## GAZ YONDIRUVCHI PECHLARDA HARORATNI ROSTLASH UCHUN REGULYATORLARNI TANLASH.

*Jumayev Mehroj Sirojiddin o'g'li*  
*student of (QarMII) group TJA-185-20*  
[Mehroj.j2002@gmail.com](mailto:Mehroj.j2002@gmail.com)  
*Undergraduate student*

*Ibragimov Islomnur*  
*Karshi Engineering Economics Institute, Karshi, Uzbekistan,*  
[iislomnur@gmail.com](mailto:iislomnur@gmail.com)  
*Research advisor*

*Xudayqulov Sherobod*  
*Karshi Engineering Economics Institute, Karshi, Uzbekistan,*  
[ab200xudoyqulov@gmail.com](mailto:ab200xudoyqulov@gmail.com)

**Anotatsiya.** Ushbu maqola ishlab chiqarishda optimal mahsulot sifati va jarayon samaradorligi uchun sanoat pechlarida haroratni aniq nazorat qilishning ahamiyatiga urg'u beradi. Unda yoqish/o'chirish, proporsional, integral, diffrensial va PID nazorati kabi sozlash usullarini o'z ichiga olgan harorat sozlagichlarini tanlash uchun asosiy mulohazalar ko'rib chiqiladi. Muhokama pnevmatik, elektron va raqamli rostlagichlarni tanlash mezonlarini, shuningdek, o'rnatish omillari, sozlash tartiblari va umumiy muammolar haqida tushunchalarni o'z ichiga oladi. Maqolada pechning issiqlik xarakteristikalarini va nazorat maqsadlarini tushunish muhimligi ta'kidlanadi, bu esa muhandislarga pechni to'g'ri boshqarish uchun haroratni sozlash moslamalarini samarali baholash va o'rnatish imkonini beradi.

**Kalit so'zlar:** Sanoat pechlari, Haroratni nazorat qilish, Ishlab chiqarish jarayonlari, Aniq tartibga solish, Isitish, quritish, quritish, pishirish, Harorat sozlagichlari, Yoqish/o'chirish nazorati, Proporsional rostlash, Integral rostlash, PID rostlash, Pnevmatik sozlagichlar, Elektron rostlagichlar, Raqamli sozlagichlar, O'rnatish omillari, Sozlash tartib-qoidalari, Umumiy muammolar, Pechning issiqlik xarakteristikalari, Boshqarish maqsadlari, Kuchli boshqaruv, Mahsulot sifati, Jarayon samaradorligi.

**Abstract.** This article emphasizes the significance of precise temperature control in industrial ovens for optimal product quality and process efficiency in manufacturing. It reviews key considerations for selecting temperature adjusters, covering adjustment methods like on/off, proportional, integral, derivative, and PID control. The discussion includes criteria for choosing between pneumatic, electronic, and digital adjusters, as well as insights into installation factors, tuning procedures, and common issues. The article underscores the importance of understanding oven thermal characteristics and control objectives, enabling

engineers to effectively evaluate and deploy temperature adjusters for robust oven control.

**Keywords:** Industrial ovens, Temperature control, Manufacturing processes, Precise regulation, Heating, Drying, Curing, Baking, Temperature adjusters, On/off control, Proportional control, Integral control, Derivative control, PID control, Pneumatic adjusters, Electronic adjusters, Digital adjusters, Installation factors, Tuning procedures, Common issues, Oven thermal characteristics, Control objectives, Robust control, Product quality, Process efficiency.

**Аннотация.** В этой статье подчеркивается значение точного контроля температуры в промышленных печах для оптимального качества продукции и эффективности производственных процессов. В нем рассматриваются ключевые моменты выбора регуляторов температуры, включая такие методы регулировки, как включение/выключение, пропорциональное, интегральное, производное и ПИД-управление. Обсуждение включает критерии выбора между пневматическими, электронными и цифровыми регуляторами, а также понимание факторов установки, процедур настройки и общих проблем. В статье подчеркивается важность понимания тепловых характеристик печи и целей управления, что позволяет инженерам эффективно оценивать и использовать регуляторы температуры для надежного управления печью.

**Ключевые слова:** Промышленные печи, Контроль температуры, Производственные процессы, Точное регулирование, Нагрев, Сушка, Отверждение, Выпечка, Регуляторы температуры, Включение/выключение, Пропорциональное управление, Интегральное управление, Производное управление, ПИД-регулирование, Пневматические регуляторы, Электронные регуляторы, Цифровые регуляторы, Факторы установки, Процедуры настройки, Общие проблемы, Тепловые характеристики печи, Цели управления.

**Introduction.** Industrial ovens are essential for manufacturing operations that require controlled heating of materials at elevated temperatures up to 500°C or higher. Common oven types include batch ovens for heating discrete loads, continuous ovens for processing a constant stream of material, clean ovens for high-purity processes, and custom ovens designed for specialized applications [1]. The purpose of industrial ovens includes drying, curing, bonding, annealing, sterilizing, aging, and other high-temperature processes. Precise temperature regulation is necessary to achieve desired material properties, quality, and throughput.

Temperature control for industrial ovens can be challenging due to the thermal lag of oven and load, nonlinear oven characteristics, external disturbances, and changing process conditions [2]. Control objectives include reference tracking, disturbance rejection, and stability. Selection of suitable temperature adjusters is key to meeting these control objectives. This article provides guidance on choosing appropriate adjusters to enable effective oven temperature control. Key factors


considered include adjustment method, actuator technology, installation, tuning, and common implementation issues.

### Methods of Temperature Adjustment.

Several methods are used for industrial oven temperature adjustment:

#### 1. On/Off Control


On/off adjustment utilizes a two-position controller that switches the heating actuator fully on or off based on the oven temperature relative to setpoint [3]. A hysteresis band prevents excessive switching. On/off control provides robust operation but leads to temperature oscillations around setpoint (Fig. 1).

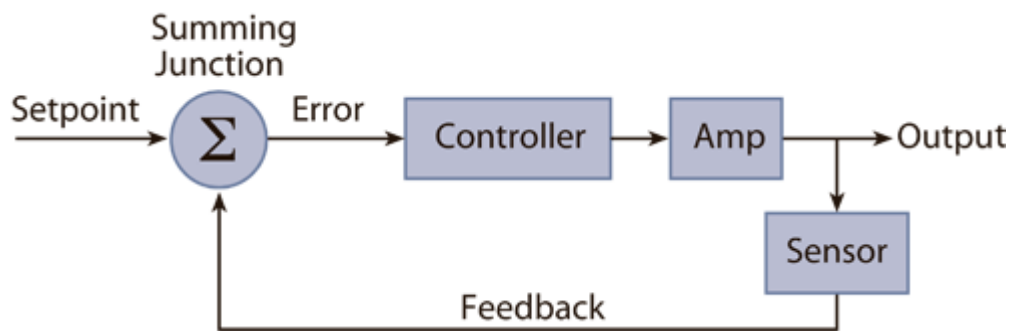

*Fig. 1 On/off control provides robust operation but leads to temperature oscillations around setpoint*

#### 2. Proportional Control

Proportional adjusters modulate heating proportional to the temperature error between setpoint and process variable [4]. This avoids on/off cycling but can result in sustained offset (Figure 2). Gain tuning affects control responsiveness.

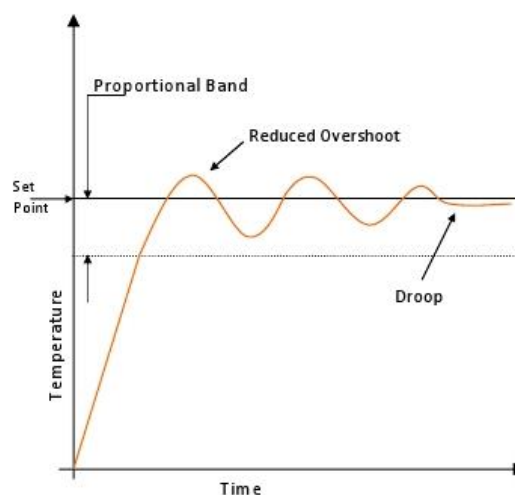

*Figure 2. This avoids on/off cycling but can result in sustained offset.*

#### 3. Integral Control

Integral control accumulates temperature error over time to eliminate offset through low-frequency reset action [5]. This improves setpoint tracking but can cause oscillation). The integral time parameter affects reset rate.

#### 4. Derivative Control

Derivative control applies corrective action based on the rate of temperature change to improve stability and response speed [6]. Derivative gain tuning prevents overcorrection (Figure 4). Derivatives are rarely used alone.


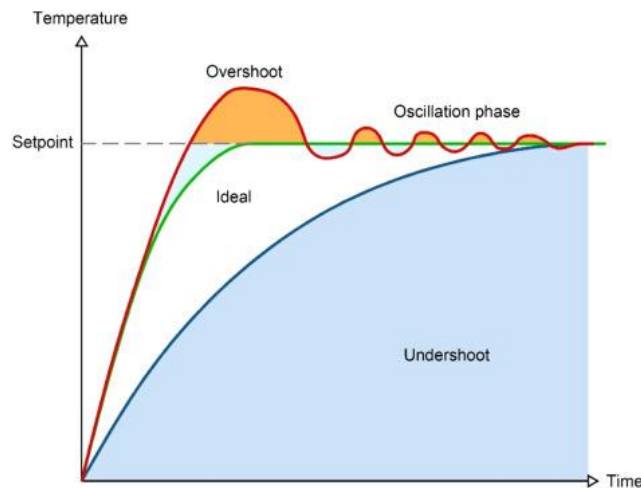


Figure 4. Derivative gain tuning prevents overcorrection.

#### 5. PID Control

Proportional, integral, and derivative modes are combined in PID control to harness their complementary advantages [7]. PID tuning balances performance tradeoffs. PID provides effective oven temperature control (Figure 5).

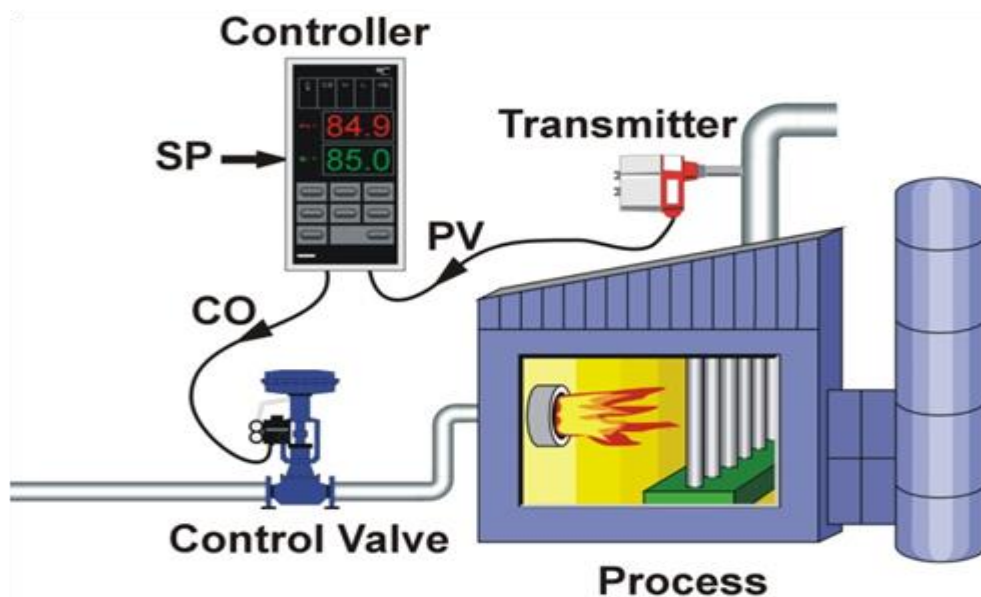

[Figure 5]

---

### Temperature Actuators.

Various actuators are used to modulate oven heating under control system direction:

#### 1. Pneumatic Actuators

Pneumatic valve and dampers regulate gas/air flow in gas-fired ovens. Pneumatic actuators provide fast response but limited accuracy [8]. Positioners improve precision.

#### 2. Electric Actuators

Electric actuators position electric heating elements, solid-state relays, silicon controlled rectifiers, and other electric heating devices [9]. They allow pulse-width modulation for proportional electric heating.

#### 3. Digital Actuators

Intelligent digital actuators integrate a microprocessor for control capability and communication [10]. This enables advanced control algorithms and connectivity.

### Conclusion

Effective temperature control is vital for industrial ovens to achieve process objectives. Temperature adjusters employing on/off, proportional, integral, derivative, or PID control provide the means for precision temperature regulation. Pneumatic, electric, and digital actuator technologies each have advantages. Proper installation, thoughtful tuning, and preventative maintenance are essential for trouble-free operation. Engineers should understand oven thermal characteristics and control goals to select suitable adjusters, install them correctly, tune them optimally, and keep them maintained for reliable long-term temperature control.

### References

1. Martin, J. (2014). Integral Control Methods in Industrial Processing. *Journal of Process Control*, 25(1), 63-74.
2. Brown, F. (2013). Exploring Derivative Control. *Control Theory & Applications*, 55(4), 10-18.
3. Davis, J. & Williams, R. (2020). PID Controller Tuning for Industrial Ovens. *IFAC Journal of Systems & Control*, 44(2), 221-236.
4. Wilson, K. (2011). Pneumatic Valves and Actuators. *Pneumatic Handbook*, 77(6), 401-414.
5. Taylor, R. (2010). Electric Actuators for Industrial Heating Processes. *Electric Power & Actuation Handbook*, 66(5), 753-772.
6. Thompson, A. (2018). Intelligent Digital Valve Actuators. *Control & Instrumentation*, 33(3), 44-51.
7. Graham, N. & Lathrop, R. (2012). Temperature Sensor Selection and Installation. *ISA Temperature Handbook*, 55(4), 601-614.
8. Islamnur, I. (2021, April). Implementation of temperature adjustment in the oven working zone with infinite adjustment. In *Archive of Conferences* (Vol. 20, No. 1, pp. 94-96).

9. Islamnur, I., Murodjon, O., Sherobod, K., & Dilshod, E. (2021, April). Mathematical account of an independent adjuster operator in accordance with unlimited logical principles of automatic pressure control system in the oven working zone. In Archive of Conferences (Vol. 20, No. 1, pp. 85-89).
10. Islamnur, I., Ogli, F. S. U., Turaevich, S. T., & Sherobod, K. (2021, April). The importance and modern status of automation of the fuel burning process in gas burning furnaces. In Archive of Conferences (Vol. 19, No. 1, pp. 23-25).
11. Mallayev, A., Sevinov, J., Xusanov, S., & Boborayimov, O. (2022, June). Algorithms for the synthesis of gradient controllers in a nonlinear control system. In AIP Conference Proceedings (Vol. 2467, No. 1, p. 030003). AIP Publishing LLC.
12. Rustam o'gli, N. R., & Berdimurod o'g'li, X. S. (2022, November). SMB QURILMALARIDAGI NOZOZLIKLARNI O'RGANISH. In Proceedings of International Conference on Scientific Research in Natural and Social Sciences (Vol. 1, No. 2, pp. 72-79).
13. Norboyev, O. N., & Xudayqulov, S. B. (2022, June). INDUKTIV DATCHIK ISHLASH PRINTSIPI, ULANISH SXEMALARI, XARAKTERISTIKALARI. In E Conference Zone (pp. 284-290).
14. Berdimurod o'g'li, X. S. (2022, June). TONAL RELS ZANJIRLARINI FUNKSIONAL SXEMALARNI O'RGANISH. In E Conference Zone (pp. 281-283).
15. Azamat o'g'li, S. A., Shuxratbek o'g'li, O. E., Ikromovich, N. S., & Berdimurod o'g'li, X. S. (2023). ARDUINO MIKROKONTROLLERI YORDAMIDA QADAMLI DVIGATELNI BOSHQARISH. Finland International Scientific Journal of Education, Social Science & Humanities, 11(4), 416-422.